

FIGURE 5a


Proposed Project at Isleton Bridge

BUILDING LAYOUT FLOOR PLAN

BUILDING, MECHANICAL, ELECTRICAL PLUMBING AND CAL-OSHA REQUIREMENTS


THESE KEYNOTES APPLY TO THIS SHEET ONLY

- L AREA SEPARATION BASED ON USES INSIDE BUILDING
- 2. FIRE WALL
- 3. WIDTH OF PATH OF TRAVEL
- 4. CLEARANCE AT DOORS
- 5. BUILDING ACCESS PATH OF TRAVEL
- 6. THRESHOLD HEIGHT
- 7. MADEQUATE LIGHTING
- 8. INADEQUATE VENTILATION
- 9. INADEQUATE CLEARANCES AT EQUIPMENT
- IO. SOUND WALL REQUIRED
- IIL NON COMPLIANT DOOR SIZE
- 12. NON COMPLIANT PLUMBING AT LAY
- IS. MADEQUATE CONTROL CONSOLE
- M. NON COMPLIANT HVAC (NONE)
- 5. NADEQUATE CLEARANCE AT TOILET
- 16. ANTIQUATED ELECTRICAL EQUIPMENT AND GENERATOR
- IT. NON COMPLIANT ELECTRICAL EQUIPMEN
- "18. NON POTABLE WATER SUPPLIED TO LAY
- 19. INADEQUATE COMBUSTION AIR FOR GENERATOR

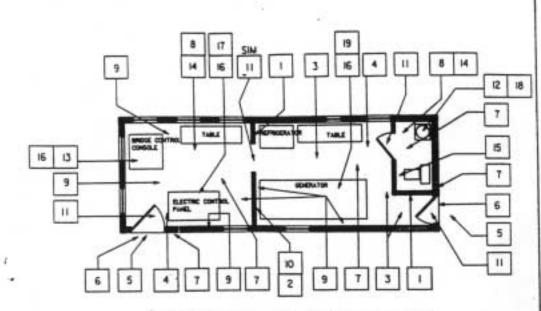

KEYNOTE FLOOR PLAN

EXISTING FLOOR PLAN SCALE 1:50

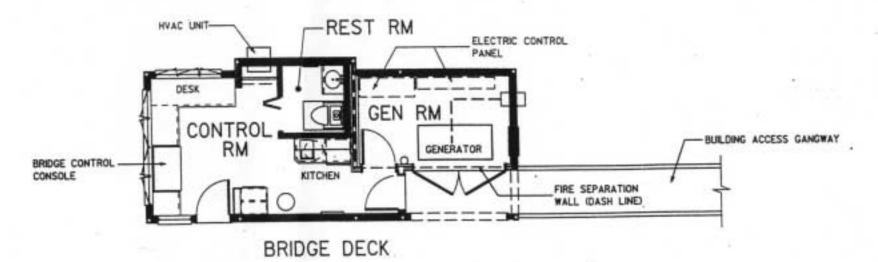

NEW FLOOR PLAN SCALE 1:50

IOI ETON DE

ISLETON BRIDGE

08-20-99